



ANNEX I - SAMPLE SINGLE LINE DIAGRAM (SLD) OF THE PROPOSED CONNECTION SCHEME

SAMPLE SLD OF DIRECT CONENCTION OF POWER PLANT A

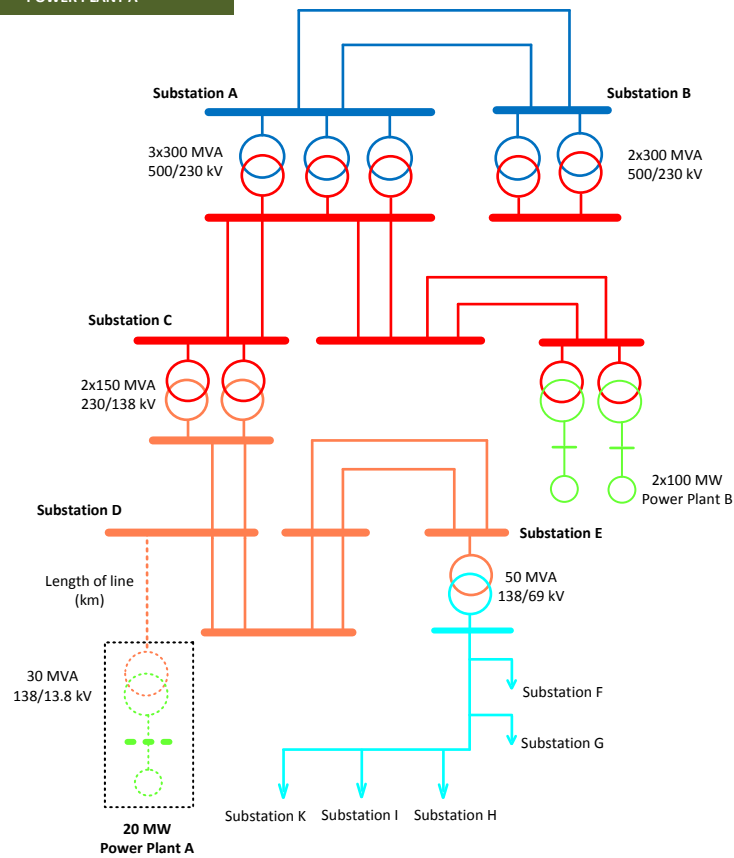

SAMPLE SLD OF TAP CAOONNECTION OF POWER PLANT A

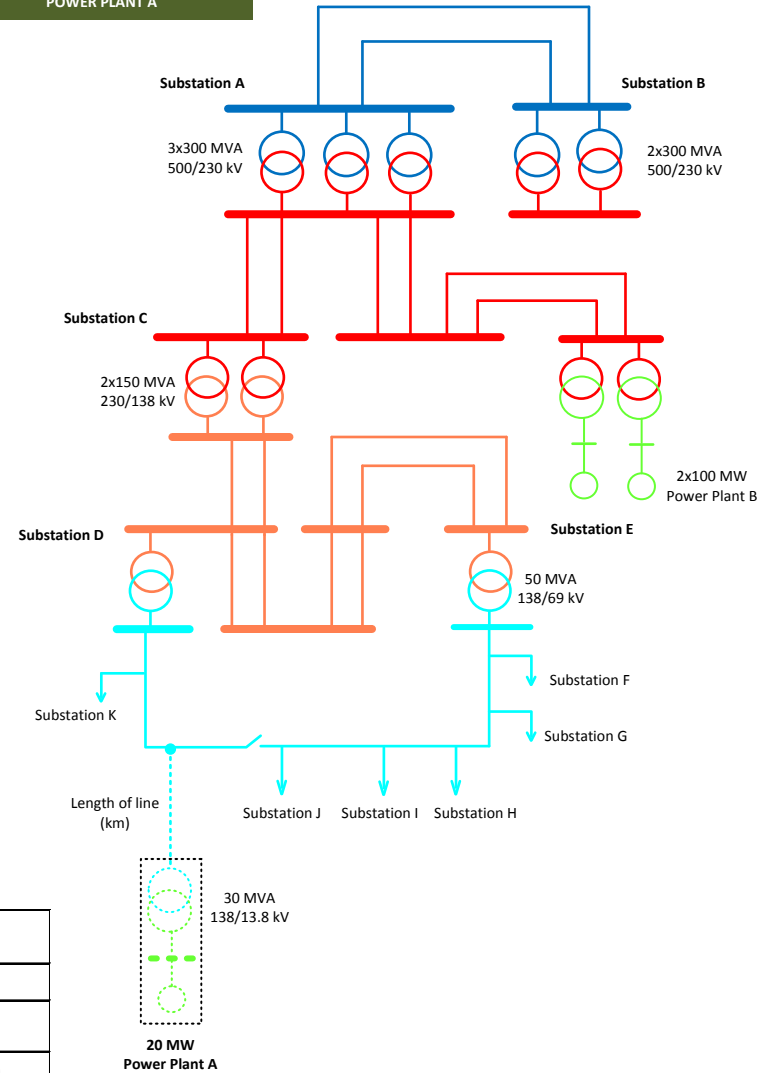

Voltage Level	Color codes		
	RGB	Hexadecimal	Name
500 kV	0, 0, 255	0000FF	Blue
350 kV DC	76, 0, 0	4C0000	Chocolate brown
230 kV	255, 0, 0	FF0000	Red
138 kV	255, 127, 80	FF7F50	Coral
115 kV	255, 191, 0	FFBF00	Yellow orange
69 kV	0, 255, 255	00FFFF	Cyan
34.5 kV	0, 100, 0	006400	Dark green
24 kV and below	0, 255, 0	00FF00	Green
Not Operational	173, 173, 173	ADADAD	Gray 68