


# PROCESS FLOW DIAGRAM CLEARANCE TO UNDERTAKE SYSTEM IMPACT STUDY ENDORSEMENT TO NATIONAL GRID CORPORATION OF THE PHILIPPINES



TOTAL PROCESSING TIME:  
**10 CALENDAR DAYS**  
(inclusive of 5 CALENDAR DAYS FOR THE PROCESSING OF NTP)

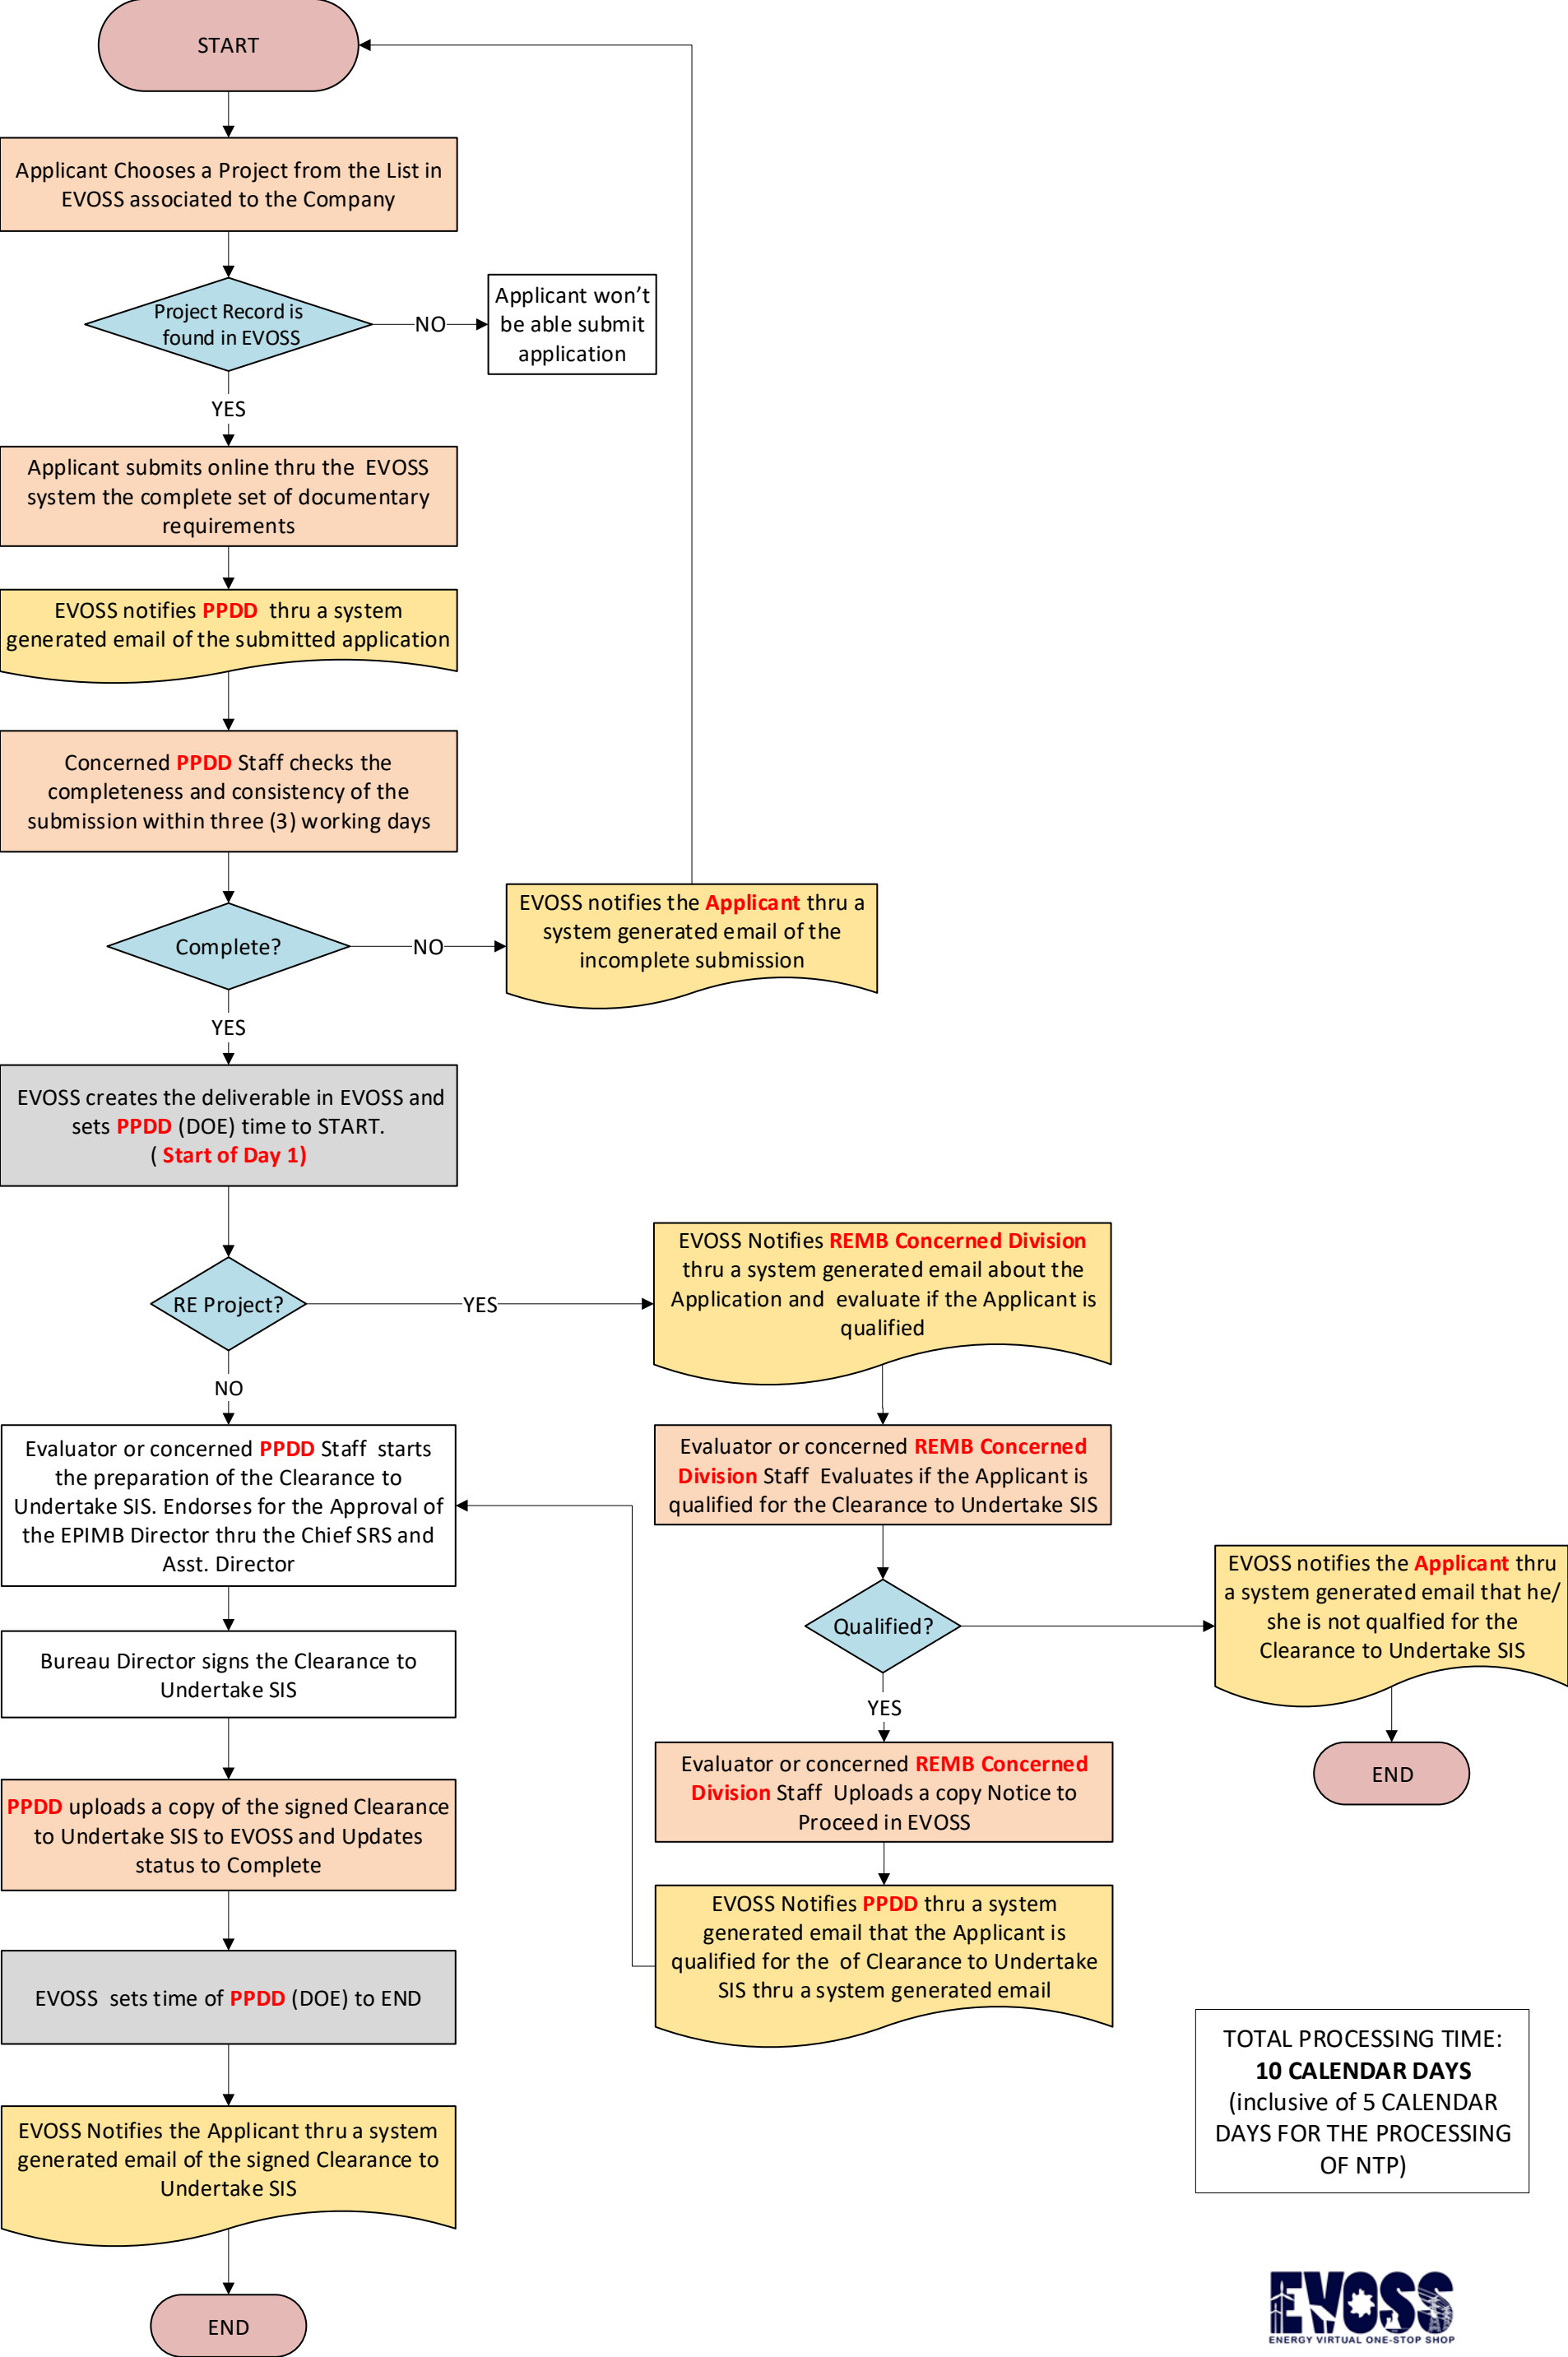